




CHULA VISTA FIRE DEPARTMENT

FIRE PREVENTION DIVISION

Water Supply - Bollards

Fire Hydrants / Fire Dept. Connections / Post Indicating Valves

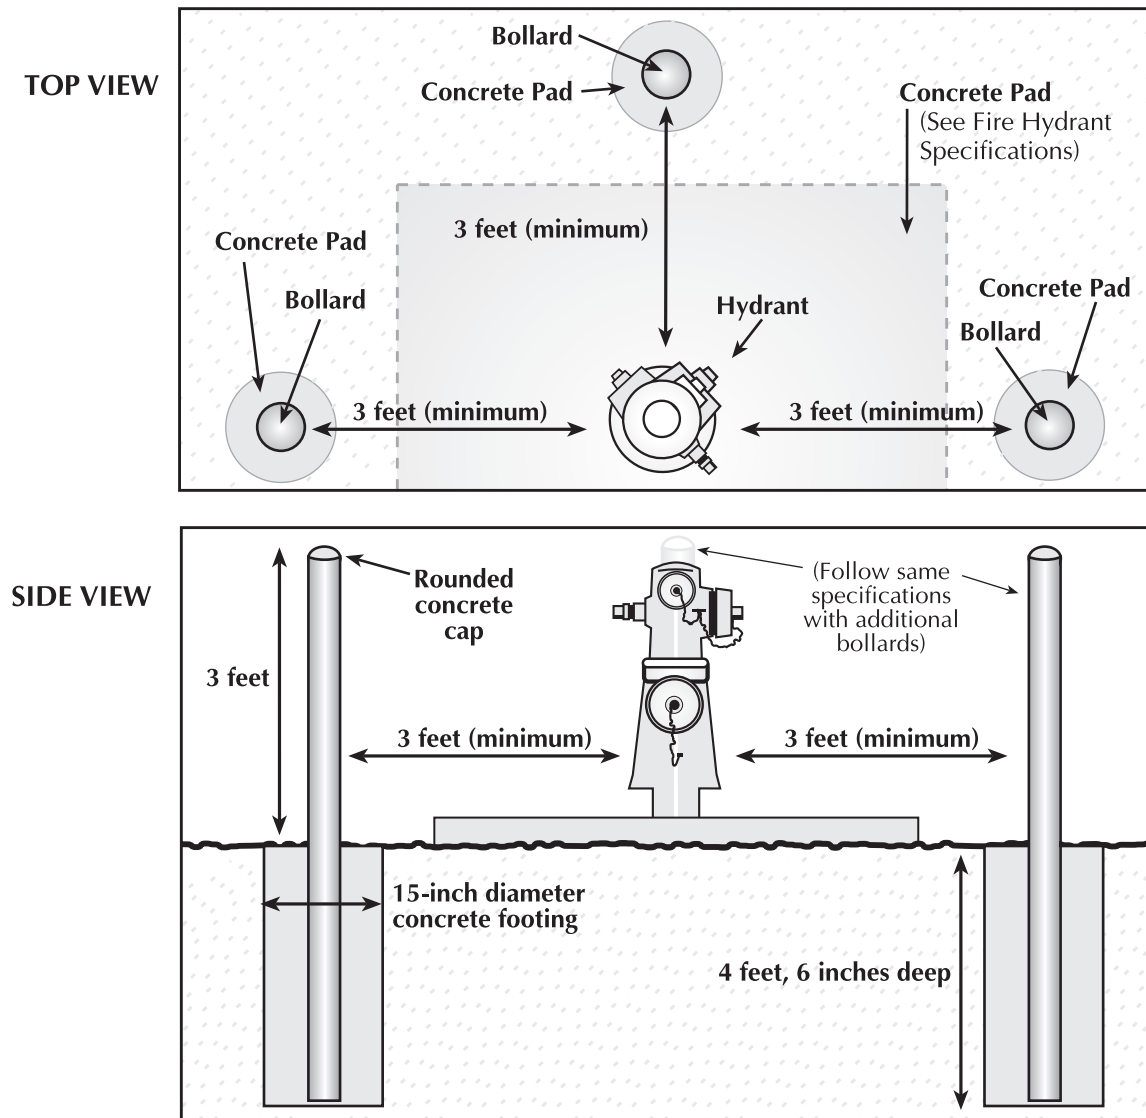

Bollard Specifications

1. Measurements **MUST** be exact and will be subject to a field inspection
2. Bollards must be 4-inch diameter galvanized steel post (1/4" wall) filled with concrete
3. A blue reflective marker must be in place to identify fire hydrant location
4. Bollards must be coated using safety yellow paint.

